



CPRI

**HIGH VOLTAGE DIVISION
CENTRAL POWER RESEARCH INSTITUTE**

P.B.NO.8066, SADHASHIVANAGAR SUB P.O.
PROF. SIR. C.V.RAMAN ROAD, BANGALORE - 560 080, INDIA.
Phone: +91 (0) 80 - 23601917 Fax: +91 (0) 80 -23601917, 23601213
MEMBER STL


Sheet 3 of 3

Test Report No.43/1/2009-HV/7271/TPL

Dated: 06-11-2009.

4. Radio Interference Voltage Test at 1MHz

Test arrangement for testing of insulators/other equipments up to including 33kV Rating.

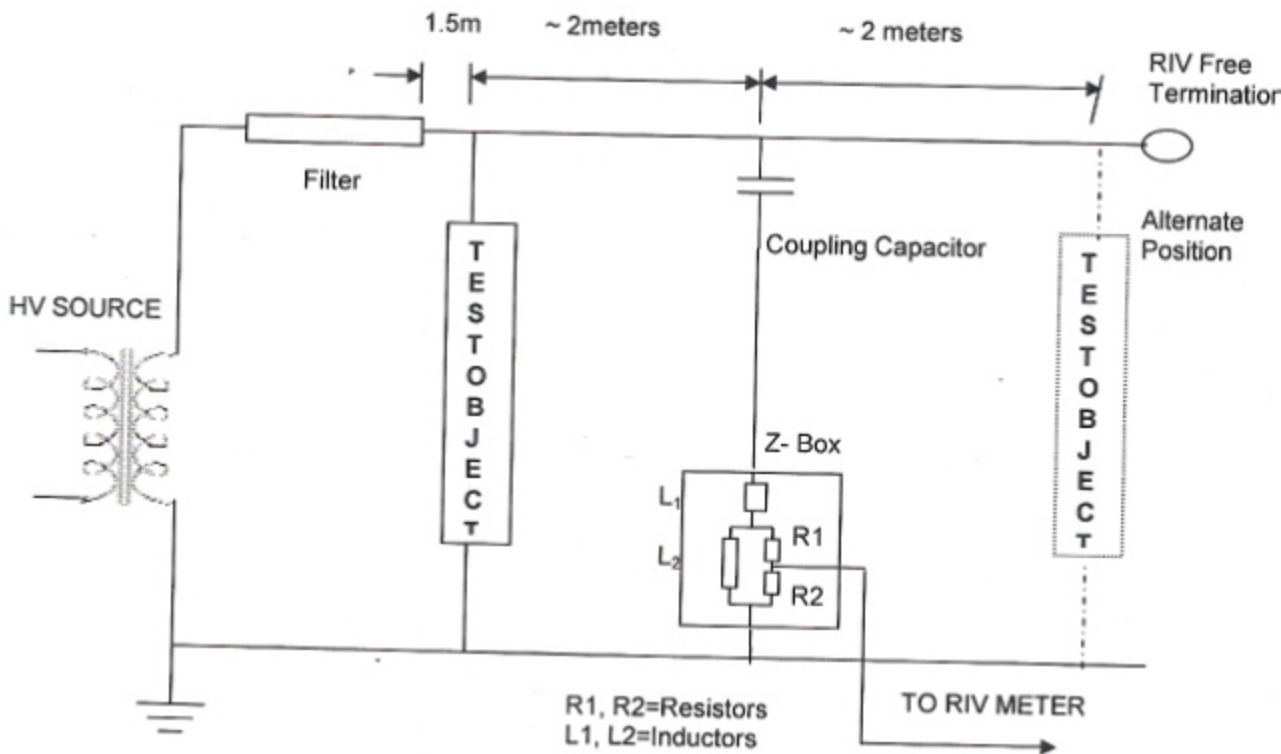

Sample No.	Test voltage in kV(rms) \$	μ V
1	30	79

* , \$ These voltages are applied under ambient conditions which are given below:

Temperature in Degree Celsius		Atmospheric Pressure in mm of Hg.	
Dry Bulb	Wet Bulb		
*	26	23	684
\$	26.5	22.5	684

(Signature)
**(K.R. DASHARATHI)
Test Engineer**